

Wind Turbine with Mechanical Power Split Transmission to Reduce the Power Electronic Devices: an Experimental Validation

Qian Liu, Rüdiger Appunn, and Kay Hameyer, *Senior Member, IEEE*

Abstract—This paper describes the structure, control and performance of a novel concept wind turbine with planetary gearbox. The power extracted from the wind is split into two parts by a free running planetary gearbox. The major part of the power is delivered to a synchronous generator, which is directly connected to the power grid without any power electronic devices. Only a very small part of the power is delivered to a servo machine, which is controlled by a small scale back-to-back converter. The servo machine operates the sun gear of the planetary gearbox. In order to show the variable speed operation with maximum power point tracking of the wind turbine at both low and high wind speed, a test bench is constructed and several experiments are performed. The experimental results in both steady state and transient state validate the performance and power split behavior of the wind turbine. The power ratio of the back-to-back converter in the new wind turbine is much smaller than the one in conventional wind turbines, which implies the possibility to reduce the power electronic devices.

Index Terms—Experimental validation, mechanical power split, planetary gearbox, reduction of power electronic devices, wind turbine.

I. INTRODUCTION

NOWADAYS, due to the environmental consideration, the renewable energy especially the wind energy plays an important role in the energy market. Moreover, for the offshore wind turbines, the rated power of a single wind turbine is growing towards 10 MW to improve the utilization of the wind energy. In the wind energy market, the existing wind turbines can be distinguished into two main categories: wind turbines with doubly fed induction generators (WT-DFIG) and wind turbines with synchronous generator (WT-SG).

For the WT-DFIG, the stator of the induction generator is directly connected to the power grid, while the rotor is supplied by a partial scale converter. The power through the converter is usually 30% of the rated power of the wind turbine [1]. Although the WT-DFIG is very popular in the wind energy market and in the research field [2]–[4], it has mechanical

difficulty for the large scale wind turbine. The crucial issue for the DFIG is its small air gap. At a large load torque, the deformation and oscillation of the rotor are critical for the DFIG [5]. Therefore, to increase the power rating of the wind turbine, more attention must be paid on the design of the DFIG and the transmission shaft. Moreover, the bear ring in the rotor also hinders the performance of the WT-DFIG [1].

The WT-SG has different types such as wind turbine with electrical excited synchronous generator (EESG) [6] or permanent magnet synchronous generator (PMSG) [7]. Moreover, the WT-SG can also be direct drive or with gearbox. However, no matter what type the WT-SG is, a full scale converter has to be utilized for the variable speed operation as well as the optimum wind power extraction. For the large scale wind turbines, the full scale converter leads to large size, high weight, high cost and high cooling burden. The design and production of large scale converter is still in development [1]. Moreover, the full scale converter results in large grid side filter. In [8], it is pointed out that the full scale converter causes more system failure in the wind turbine, when compared to the partial scale converter.

Therefore, both existing conventional wind turbine structures have difficulties and shortages for the large scale wind turbine. To increase the rated power of the wind turbine, it is expected that the wind turbine is with the synchronous generator, while the scale of the converter can be reduced. In [9], a new wind turbine with a DFIG and an additional PMSG as exciter is developed to improve the power quality and fault ride through capability. However, this structure still has a DFIG as the main generator and has the same rotor side control as conventional WT-DFIG for the variable speed operation. Therefore, the power through the converter and the exciter generator is still about 30% of the rated power of the wind turbine. In [10], a wind turbine with power split, which is realized mechanically by a free running planetary gearbox, is proposed. This wind turbine contains a synchronous generator and a servo machine. The synchronous generator is directly connected to the power grid, while the servo machine is with a partial scale converter. A theoretical analysis of the wind turbine with planetary gearbox is shown in [11] for the power split behavior. It is pointed out that the power delivered to the partial scale converter can be less than 10% of the rated power of the wind turbine. In [12], the drive train control to realize the variable speed operation of a wind turbine with planetary and a special two-mode gearbox is introduced. However, in the

Manuscript received July 25, 2016; revised October 5, 2016; accepted October 10, 2016. This work was supported by the Ziel-2-Programm NRW 2007-2013 "Regionale Wettbewerbsfähigkeit und Beschäftigung" (EFRE).

The authors are with the Institute of Electrical Machines, RWTH Aachen University, 52062 Aachen, Germany (e-mail: qian.liu@iem.rwth-aachen.de).

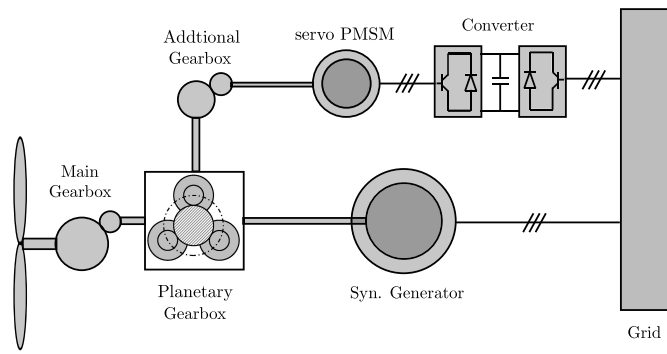


Fig. 1: Structure of the wind turbine with power split.

aforementioned literature, the feasibility, operation and power split behavior of the wind turbine with planetary gearbox lack convincing support such as test bench and experiments.


This paper is divided into two parts. The first part is the description, analysis and control of the wind turbine with a special planetary gearbox. Due to the special structure, the drive train control of the wind turbine with power split is carefully designed. In the second part of this paper, a test bench and experimental results for the wind turbine with planetary gearbox are shown. The experiments are investigated with constant, ramp and stochastic wind speed. The variable speed operation with maximum power point tracking (MPPT) and small power ratio to the converter are validated by the experimental results, which shows the possibility for the reduction of the power electronic devices.

II. WIND TURBINE WITH POWER SPLIT


Similar to the power train of the hybrid electrical vehicles, the structure of the proposed wind turbine with power split is shown in Fig. 1. The main components of the wind turbine with power split consist of a turbine system, a main gearbox, a free running planetary gearbox, an electrical excited synchronous generator, a servo PMSM and a back-to-back converter. The main gearbox is with a one or two stage structure so that the rated speed of the main shaft at the high speed side is about 400rpm to 600rpm. The power split is realized by the planetary gearbox, with which the extracted wind power is delivered to the synchronous generator and the servo PMSM. The synchronous generator is directly connected to the power grid. Meanwhile, the servo PMSM, which is the main control unit of the drive train, is supplied by a small scale back-to-back converter. The additional transmission gearbox, which is optional, is to adjust the speed-torque operating curve of the servo PMSM.

A. Aerodynamics and power curve of the turbine

The turbine system of the wind turbine with power split is the same as that of the traditional wind turbine. The extracted wind power of the turbine system is proportional to the kinetic energy in a cylinder of air traveling with wind speed v_w within

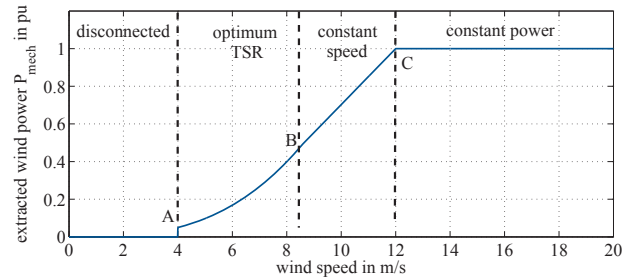

(a)

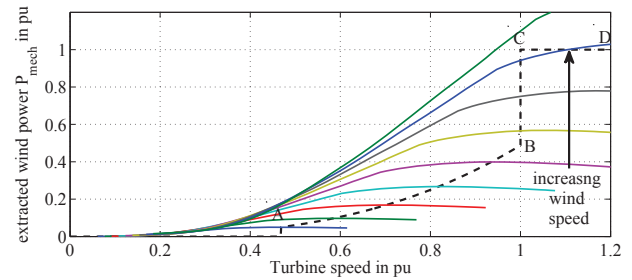

(b)

Fig. 2: Power curves of an exemplary wind turbine: (a) power curve with wind speed; (b) power curve with turbine speed.

the rotor swept area of the turbine system [13]. It can be presented by the following equation:

$$P_{mech} = \frac{1}{2} \rho_{air} \pi R_t^2 C_p(\lambda, \beta) v_w^3, \quad (1)$$

where ρ_{air} is the air density. R_t is the radius of the rotor swept area. $C_p(\lambda, \beta)$ is the performance coefficient, which denotes the percentage of the wind power extracted by the turbine system. $C_p(\lambda, \beta)$ is a function of the tip speed ratio (TSR) $\lambda = \frac{\omega_t R_t}{v_w}$ and the pitch angle of the blades β . ω_t is the rotational speed of the turbine. The performance coefficient C_p depends on the structure and aerodynamic characteristics of the turbine. The maximum value of C_p stays at an optimum pitch angle (usually at 0°) and an optimum TSR. With increasing pitch angle, the performance coefficient C_p drops, which reduces the extracted power from the wind.

At low or median wind speed, the turbine system is with maximum performance coefficient for optimum wind power extraction. At high wind speed, the pitch angle is increased to limit the power and speed of the turbine [14]. Exemplary mechanical power curves of the wind turbine are shown in Fig.2a and by the dashed curve in Fig.2b depending on the wind speed and the turbine speed respectively. When the wind speed is smaller than a given value, which is named as cut-in wind speed, the losses of the wind turbine are larger than the available wind power. The generator is disconnected to the power grid and the turbine is stalled so that the mechanical power of the turbine is zero. Along the curve between A to B, which is called optimum TSR region, the pitch angle and the speed of the turbine are controlled to the optimum values so that optimum TSR and the maximum C_p as well as the optimum wind power extraction can be achieved. On the curve between B to C, which is named as constant speed region, the speed of the turbine stays at its rated value and the pitch

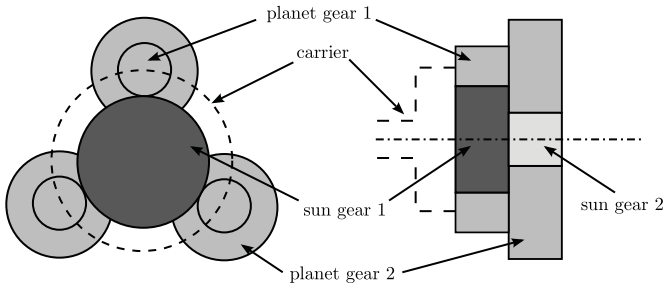


Fig. 3: Structure of the special planetary gearbox.

angle is controlled. The extracted wind power is increasing with the increment of wind speed until the rated power of the turbine is reached. Due to the limited pitch rate of the wind turbine, it is possible that the turbine speed accelerates above the rated value, which is illustrated by the dashed line between operating points C and D in Fig. 2b. However, if the pitch rate is large, the overshoot above the rated speed is negligible and the maximum turbine speed can be considered as its rated speed [14]. When the wind speed is higher than a critical value, which is named as the cut-off wind speed value, the generator is disconnected to the power grid and the turbine is stalled to protect the wind turbine.

B. Planetary gearbox

The standard planetary gearbox has three terminals: a ring gear, a sun gear and a carrier. The structure and dynamic model of the standard planetary gearbox can be found in [15] and [16]. In the proposed wind turbine and the test bench, a special planetary gearbox is utilized to improve the efficiency. The structure of the special planetary gearbox is shown in Fig. 3. When compared to the standard planetary gearbox, the special planetary gearbox has no ring gear. Each planet gear has two different radii, which realizes the gear ratio between two sun gears. The two sun gears are separated and actuated by the planet gears, which are attached to the carrier.

In the gearbox, the oil friction losses depend on the contact area of the gears [17]. In the special planetary gearbox mentioned above, there is no ring gear with large radius. The contact area in the aforementioned special planetary gearbox is smaller than that in the standard one. Therefore, the oil friction losses can be reduced by the special planetary gearbox [12].

Moreover, the sun gear 1, sun gear 2 and the carrier in the special planetary gearbox are equivalent to the carrier, sun gear and ring gear in the standard planetary gearbox respectively. The dynamic equation of the special planetary gearbox has the same form as that of the standard one:

$$\begin{bmatrix} \dot{\omega}_{s1} \\ \dot{\omega}_{s2} \end{bmatrix} = \begin{bmatrix} -k_{11} & -k_{12} \\ -k_{21} & -k_{22} \end{bmatrix} \begin{bmatrix} \omega_{s1} \\ \omega_{s2} \end{bmatrix} + \begin{bmatrix} a_{11} & a_{12} & a_{13} \\ a_{21} & a_{22} & a_{23} \end{bmatrix} \begin{bmatrix} T_{s1} \\ T_{s2} \\ T_c \end{bmatrix}, \quad (2)$$

where T is the torque and the subscript s1, s2 and c denote sun gear 1, sun gear 2 and carrier. The parameters k_{ij} and a_{ij} are the lumped friction and inertia coefficients. The relationship of the speed is described by the following equation: where T

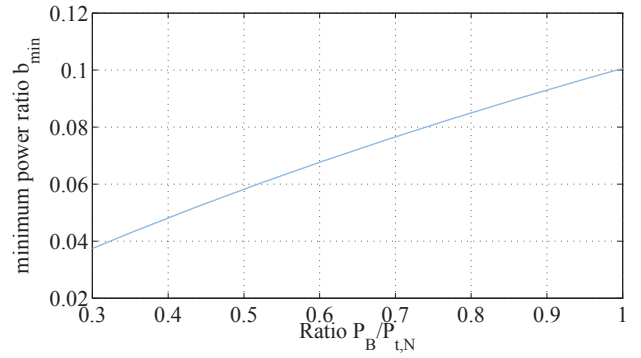


Fig. 4: Minimum power ratio delivered to the servo PMSM.

is the torque and the subscript s1, s2 and c denote sun gear 1, sun gear 2 and carrier. The parameters k_{ij} and a_{ij} are the lumped friction and inertia coefficients. The relationship of the speed is described by the following equation:

$$(1 - i_0)\omega_{s1} = \omega_{s2} - i_0\omega_c. \quad (3)$$

The gear ratio of the plus planetary gearbox i_0 is obtained by the following equation:

$$i_0 = \frac{(r_{p1} - r_{p2})(r_{p2} + r_{s2})}{r_{p1}r_{s2}}, \quad (4)$$

where r_{p1} , r_{p2} and r_{s2} are the radii of the planet gear 1, planet gear 2 and sun gear 2 respectively. In the steady state, if the friction is neglected, the model of the special planetary gearbox can be simplified into the following form:

$$T_{s2} = -\frac{1}{1 - i_0}T_{s1}, \quad (5)$$

$$T_c = \frac{i_0}{1 - i_0}T_{s1}. \quad (6)$$

Therefore, the special planetary gearbox has the same steady state model as the standard planetary gearbox shown in [11]. The investigated wind turbine in this paper has the following structure: the main shaft is connected to the sun gear 1; the synchronous generator is connected to sun gear 2; the carrier is connected to the additional gearbox which delivers torque to the servo PMSM. The theoretical and practical aspects to scale up the components of a wind turbine such as gearbox can be found in [18].

C. Minimum power to servo PMSM

During the variable speed operation of the wind turbine, the servo machine (PMSM) is operated in both generator and motor mode. For the power delivered to the servo PMSM and the converter, the same analysis for the power split behavior as shown in [11] is supplied. There is no explicit function between the real time demanded power of the servo PMSM and the turbine power. Since the special planetary gearbox has the same steady state model as the standard planetary gearbox, all the conclusions for the minimum power split in [11] can be directly applied for the wind turbine structure in Fig. 1. In the analysis, the wind turbine is assumed in ideal operation and the losses in the gearboxes are neglected.

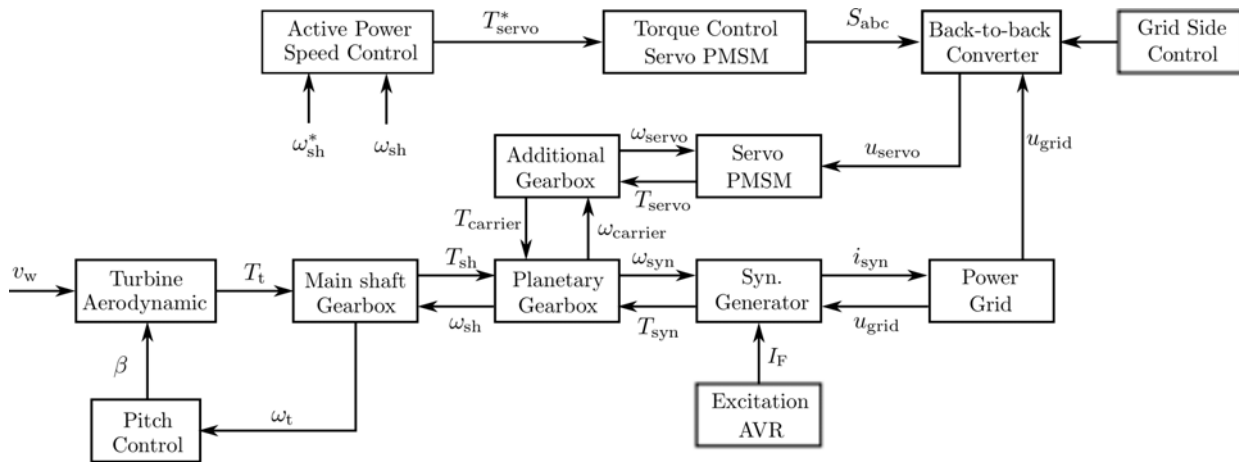


Fig. 5: Control diagram and signal flow for the proposed wind turbine.

The minimum power split depends on the gear ratios of the main and planetary gearboxes. Denoting $P_{servo,N}$ and $P_{t,N}$ as the peak mechanical power of the servo PMSM in full wind speed range and the rated mechanical power of the turbine, the minimum ratio $b_{min} = \min\{\frac{P_{servo,N}}{P_{t,N}}\}$ can be obtained by $b_{min} = 1 - a_{opt}$, where a_{opt} is the solution of the following equation:

$$1 - a_{opt} = \frac{4}{27} \frac{P_B}{P_{t,N}} a_{opt}^3. \quad (7)$$

Here P_B is the mechanical power of the turbine at the end of the optimum TSR region, which is illustrated by the operating point B in Fig. 2. However, to reach the minimum power for the servo PMSM, the gear ratios of the main and planetary gearboxes have to fulfill the following relationship:

$$i_0 = 1 - \frac{\omega_1}{i_m \omega_{t,N} a_{opt}}, \quad (8)$$

where i_m is the gear ratio of the main gearbox. $\omega_{t,N}$ is the rated speed of the turbine and ω_1 is the synchronous speed of the synchronous generator in mechanical radian. The ideal minimum power ratio of the servo PMSM is shown in Fig. 4. Therefore, for the structure in Fig. 1, the ideal minimum power split can be less than 10% of the rated power of the turbine, which indicates the possibility for the reduction of power electronic devices.

III. CONTROL OF THE WIND TURBINE

Since the structure of the wind turbine with power split is more complicated when compared to the existing standard wind turbines, particular attention has to be paid to the control of the drive train of the wind turbine with power split. The control scheme of the wind turbine with power split can be divided into five parts: pitch control, active and reactive power control, the synchronization of the synchronous generator and the control of the back-to-back converter. The control diagram and the signal flow of the proposed wind turbine is shown in Fig. 5. In the figure, T , ω , u and i denote the torque, rotational speed, voltage and current respectively. The subscript t, sh and syn denote the turbine, main shaft and synchronous generator respectively. The superscript * represents the reference value.

β is the pitch angle and I_F is the excitation current of the synchronous generator. S_{abc} is the switching signal for the rotor side converter. For the grid side control of the back-to-back converter, existing strategies such as reported in [19] for the traditional wind turbines can be applied. For the reactive control of the wind turbine, it can be easily achieved by the standard exciter control and automatic voltage regulator (AVR) in the electrical excited synchronous generator. Therefore, the reactive power of the wind turbine with power split can be regulated in the same way as the conventional hydro power plant, which is more convenient than that in the existing WT-DFIG and WT-SG. For the pitch control, synchronization and active power control, they have to be designed based on the structure of the planetary gearbox [12].

A. Synchronization of synchronous generator

In the wind turbine with planetary gearbox, the synchronous generator is directly connected to the power grid. The synchronization for the synchronous generator has to be fulfilled during the transient operation of the wind turbine. Fortunately, the synchronous generator itself is a stable system during the transient operation such as sudden load change. It can recover synchronism when the mechanical power does not exceed its maximum pull down power [20]. The extracted wind power is limited by the pitch control and active power control. Moreover, the frequency oscillation is damped by the damper winding of the synchronous generator. Therefore, when the synchronous generator is properly chosen, no particular attention has to be paid on the synchronization.

B. Active power control

The active power control is realized by the servo PMSM in the wind turbine with power split. Due to the excellent controllability of the servo PMSM, the torque response time can reach several milliseconds using both direct torque control (DTC) and field oriented control (FOC). This can provide fast torque dynamics to protect the wind turbine during wind gust. Since the structure of the planetary gearbox is complicated, it is inconvenient to obtain the optimum torque reference for

the servo PMSM considering the losses. The variable speed operation as well as the MTTP is realized by the speed control over the speed of the main shaft to achieve the optimum TSR. The reference speed of the turbine $\omega_t^*(v_w)$ is set to:

$$\omega_t^*(v_w) = \begin{cases} \frac{v_w \lambda^*(v_w)}{R_t} & \text{if } \frac{v_w \lambda^*(v_w)}{R_t} \leq \omega_{t,N} \\ \omega_{t,N} & \text{otherwise} \end{cases} \quad (9)$$

Here $\lambda^*(v_w)$ is the optimum TSR according to the wind speed. The reference speed for the main shaft is obtained by:

$$\omega_{sh}^*(v_w) = i_m \omega_t^*(v_w). \quad (10)$$

Using equation 2, the dynamic of the speed on the main shaft ω_{sh} can be formulated as follows:

$$\dot{\omega}_{sh} = -k_{11}\omega_{sh} - k_{12}\omega_{syn} + a_{11}T_{sh} + a_{12}T_{syn} + i_z a_{13}T_{servo}, \quad (11)$$

where T is the torque and the subscript sh, syn and servo denote the main shaft, synchronous generator and servo PMSM respectively. i_z is the gear ratio of the additional transmission gearbox. For the convenience of the controller design, equation (11) is reformulated into:

$$\dot{\omega}_{sh} = -k_{11}^*\omega_{sh} + i_m a_{13}^* T_{servo} + T_{dis}, \quad (12)$$

where k_{11}^* and a_{13}^* are the references for the coefficients k_{11} and a_{13} . T_{dis} is a general disturbance represented by:

$$T_{dis} = -(k_{11} - k_{11}^*)\omega_{sh} - k_{12}\omega_{syn} + a_{11}T_{sh} + a_{12}T_{syn} + i_z(a_{13} - a_{13}^*)T_{servo}. \quad (13)$$

Since it is costly to measure or estimate the disturbance torque T_{dis} , a sliding mode controller over the speed of the main shaft is introduced to improve the performance. Denoting T_{dis}^{max} as the bound of the disturbance, we have $|T_{dis}| < T_{dis}^{max}$. A sliding plane is chosen as:

$$s = \omega_{sh}^* - \omega_{sh} + c \int (\omega_{sh}^* - \omega_{sh}) dt, \quad (14)$$

where c is a positive constant. Considering the Lyapunov function $V = \frac{s^2}{2}$, its derivative is shown as follows:

$$\dot{V} = s[k_{11}^*\omega_{sh} - i_z a_{13}^* T_{servo} - T_{dis} + c(\omega_{sh}^* - \omega_{sh})]. \quad (15)$$

Using the standard design of sliding mode controller:

$$T_{servo} = \frac{1}{i_z a_{13}^*} [\text{sign}(s) T_{dis}^{max} + k_{11}^*\omega_{sh} + c(\omega_{sh}^* - \omega_{sh})], \quad (16)$$

the derivative of the Lyapunov function is reformulated into:

$$\dot{V} = s(-T_{dis} - \text{sign}(s) T_{dis}^{max}) \leq 0. \quad (17)$$

The equal holds if and only if $s = 0$. Therefore, the sliding mode controller (16) ensures that the optimum TSR of the turbine as well as the MTTP. In order to eliminate the chattering effect for the sliding mode controller, the discrete function $\text{sign}(s)$ is replaced by its continuous approximation:

$$f(s) = \begin{cases} \frac{s}{\sigma} & \text{if } |s| < \sigma \\ \text{sign}(s) & \text{otherwise} \end{cases} \quad (18)$$

where σ is a small positive constant.

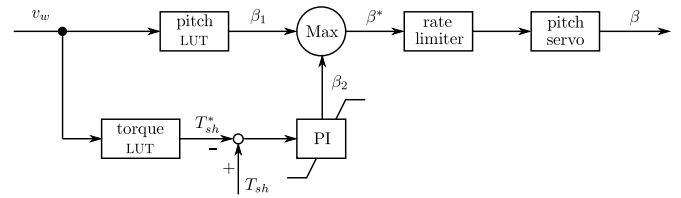


Fig. 6: Pitch control of the wind turbine with power split.

C. Pitch control

Since the active power control is realized by the speed control of the main shaft, the pitch angle may be stabilized to the non-optimal value, when a pitch controller on turbine speed is applied. It is possible that the extracted wind power is much smaller than the optimum value at high wind speed [12]. Therefore, a pitch controller over the torque of the main shaft is implemented.

The structure of the pitch controller is shown in Fig. 6. It contains the look-up table (LUT) of the reference pitch angle β_1 , which is the solution of the following equation at different wind speed:

$$C_p(\lambda^*(v_w), \beta) = C_p^*(v_w) = \frac{P_t^*(v_w)}{0.5 \rho_{air} \pi R_t^2 v_w^3}. \quad (19)$$

Here $P_t^*(v_w)$ is the reference power of the turbine according to the reference power curve. C_p^* is the reference performance coefficient. The torque LUT $T_{sh}^*(v_w)$ is also calculated by the power curve of the turbine:

$$T_{sh}^*(v_w) = \frac{P_t^*(v_w)}{\omega_{sh}^*(v_w)}. \quad (20)$$

A PI controller with anti-windup is implemented on the torque error to obtain β_2 . The rate limiter of the pitch angle depends on the dynamics of the pitch motor. It is usually around 8° s^{-1} to 10° s^{-1} [21].

The pitch controller combining a pitch LUT and a torque control is to guarantee the safety and performance of the wind turbine for both smooth wind speed and wind gust. For smooth wind speed, the pitch LUT is dominant so that the pitch angle is controlled to its optimum value for the optimum wind power capture. During the wind gust, particularly at high wind speed, the sudden increment of the captured wind power results in high torque and unexpected acceleration of the turbine speed. In this case, the torque control is dominant in the pitch controller. When the PI controller is well parameterized with fast dynamics, the torque of the turbine can be controlled within the pre-defined range by the pitch angle. Therefore, the servo PMSM can provide sufficient torque to counteract the acceleration of the turbine and to protect the wind turbine.

D. Controllability considering Grid Codes

For the wind turbine with power split, the main synchronous generator is electrically excited and directly connected to the power grid. Therefore, it inherits the controllability and advantages of a traditional hydro power plant when considering the grid codes. For the frequency deviation, a droop control is able to be added to the pitch angle to regulate the output active

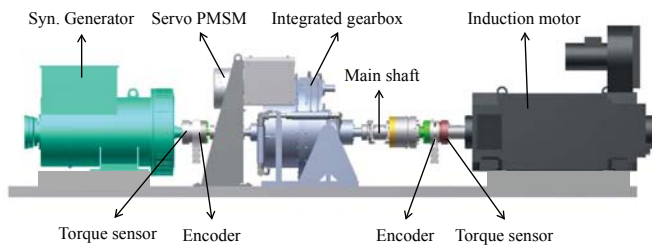


Fig. 7: Structure of the mechanical setup in the test bench.

Synchronous generator		Servo PMSM	
Rated power	200 kW	Rated power	66 kW
Rated voltage	690 V	Rated speed	2000 rpm
Rated speed	1500 rpm	Rated torque	314 Nm

Integrated gearbox		Induction motor	
Rated power	220 kW	Rated Power	190 kW
Planetary gearbox	$i_0 = -2,41$	Rated speed	800 min ⁻¹
Additional gearbox	$i_z = 7,83$	Rated Torque	2268 Nm

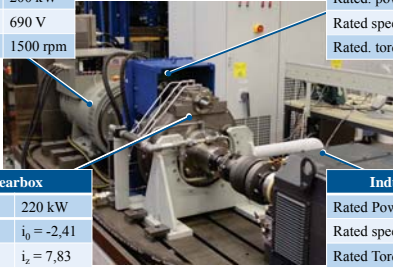


Fig. 8: Data of the experimental setup.

power. Moreover, the demanded voltage and reactive power for the grid codes is easily achieved by the exciter control and AVR system of the synchronous generator.

On the other hand, traditional synchronous generator has strong fault ride through capability during the system fault such as voltage dip [22]. The exciter control and AVR system of the synchronous generator is able to reduce the excitation current to limit the short-circuit current in the generator. Meanwhile, the servo PMSM is disconnected from the converter and can be connected to a crow-bar. In this case, the short circuit current in the servo PMSM can be damped by the crow-bar and the speed of the servo PMSM is reduced towards 0. Therefore, the wind turbine with power split is able to stay connected with the power grid during voltage dip. Moreover, when compared to the WT-DFIG, the exciter control and AVR system can achieve full controllability of the short-circuit current in the generator. This indicates, the wind turbine with mechanical power split has better fault ride through capability when compared to the WT-DFIG.

IV. EXPERIMENTAL SETUP

In order to validate the feasibility, power split behavior and performance of the aforementioned wind turbine with power split, a test bench is constructed (Fig. 1). The structure of the mechanical system in the test bench is shown in Fig. 7. The induction motor is to emulate the turbine, main gearbox and the pitch controller. The integrated gearbox is a compact combination of the special planetary gearbox and the additional transmission gearbox. The connection of the special planetary gearbox is shown at the end of section II-B. The torque and speed of the main shaft, the synchronous generator and the servo PMSM are measured. The ratings of the experimental setup are shown in Fig. 8. The synchronous

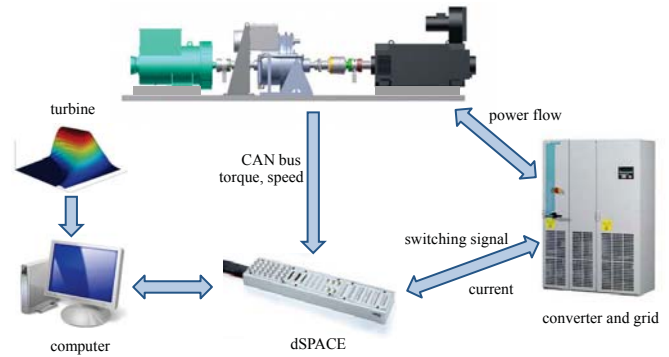


Fig. 9: Structure of the entire system in the test bench.

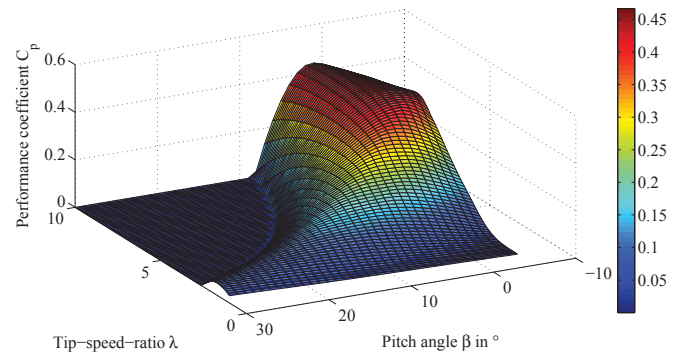


Fig. 10: Performance coefficient of a 6 MW turbine.

generator is directly connected to the 690 V power grid. The servo PMSM is connected to a back-to-back converter with DC-link voltage 600 V.

The setup for the entire system of the test bench is illustrated in Fig. 9. The experiments are realized by the dSPACE rapid prototyping system with Hardware-in-the-Loop (HIL). The electrical quantities on grid side for the synchronous generator and the converter is measured by the Yokogawa power analyzer. For the emulation of the turbine system, the aerodynamics of the turbine, the gear ratio of the main gearbox i_m and the pitch controller, which are described in the previous sections, are modeled and implemented in the dSPACE system. The emulated torque of the turbine after the main gearbox is realized by the induction motor.

In the test bench, the emulated turbine is down scaled from a 6 MW turbine, whose performance coefficient is shown in Fig. 10. Due to the limited torque of the induction motor, a turbine system with a rated mechanical power of 110 kW is emulated for the experiments. The parameters of the emulated turbine can be found in Appendix A. The power curves shown in Fig. 2 with power ratio $\frac{P_B}{P_{t,N}} = 0.488$ are supplied to the emulated turbine. According to section II-C, the ideal minimum power split to the servo machine is 5.8% of the rated mechanical of the turbine, while the optimum gear ratio of the main gearbox $i_{m,opt} = 32.8$. However, due to the very weak field weakening capability of the used servo PMSM and in order to achieve a wide wind speed operation, the gear ratio of the main gearbox i_m deviates from its ideal optimum value.

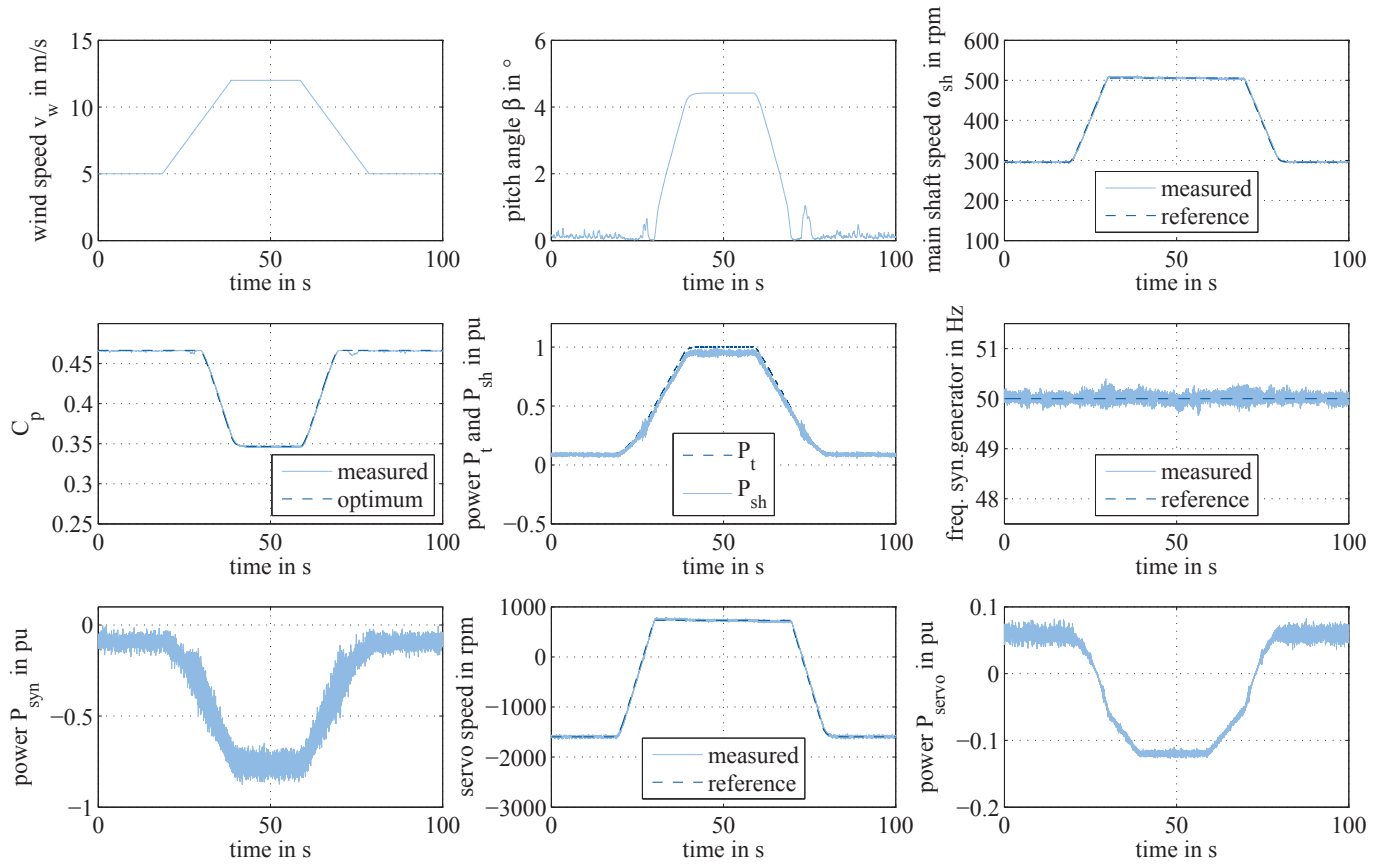


Fig. 11: Experimental results of the wind turbine with ramp wind speed.

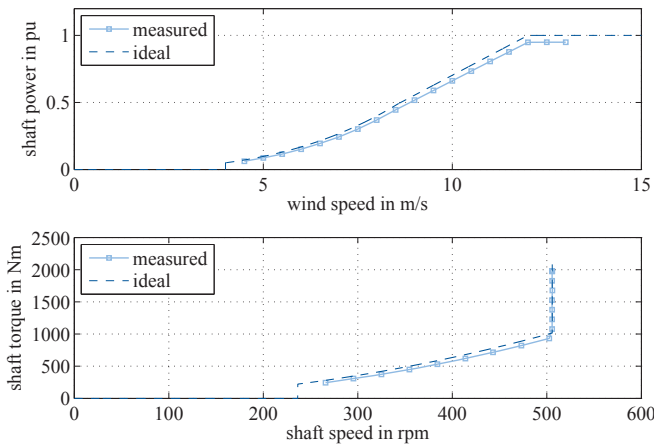


Fig. 12: Ideal and measured operating curves of main shaft.

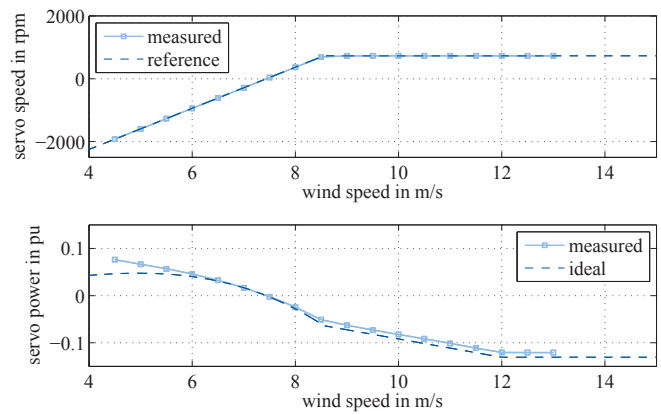


Fig. 13: Ideal and measured operating curves of servo PMSM.

V. EXPERIMENTAL RESULTS

The experiments are performed with ramp, steady state and stochastic wind to illustrate the performance of the wind turbine with power split. In the experimental results, the positive and negative power represent motor mode and generator mode respectively. The power is normalized by the rated power of 110 kW.

The experimental results for the ramp wind speed from 5 m/s to 12 m/s are shown in Fig. 11. The power in the figure is the mechanical power of each component. With the proposed

control scheme, the speed of the main shaft closely tracks its optimum reference value so that the optimum TSR are achieved. Moreover, the pitch angle at low and median wind speed is approximately zero, while it increases at high wind speed. The performance coefficient C_p tracks its optimum reference value so that the MPPT can be achieved for the wind turbine with power split. The measured mechanical power P_{sh} delivered to the main shaft is slightly smaller than that of the turbine P_t due to the friction losses. The frequency of the synchronous generator stays closely around the grid frequency of 50 Hz so that the synchronization is achieved.

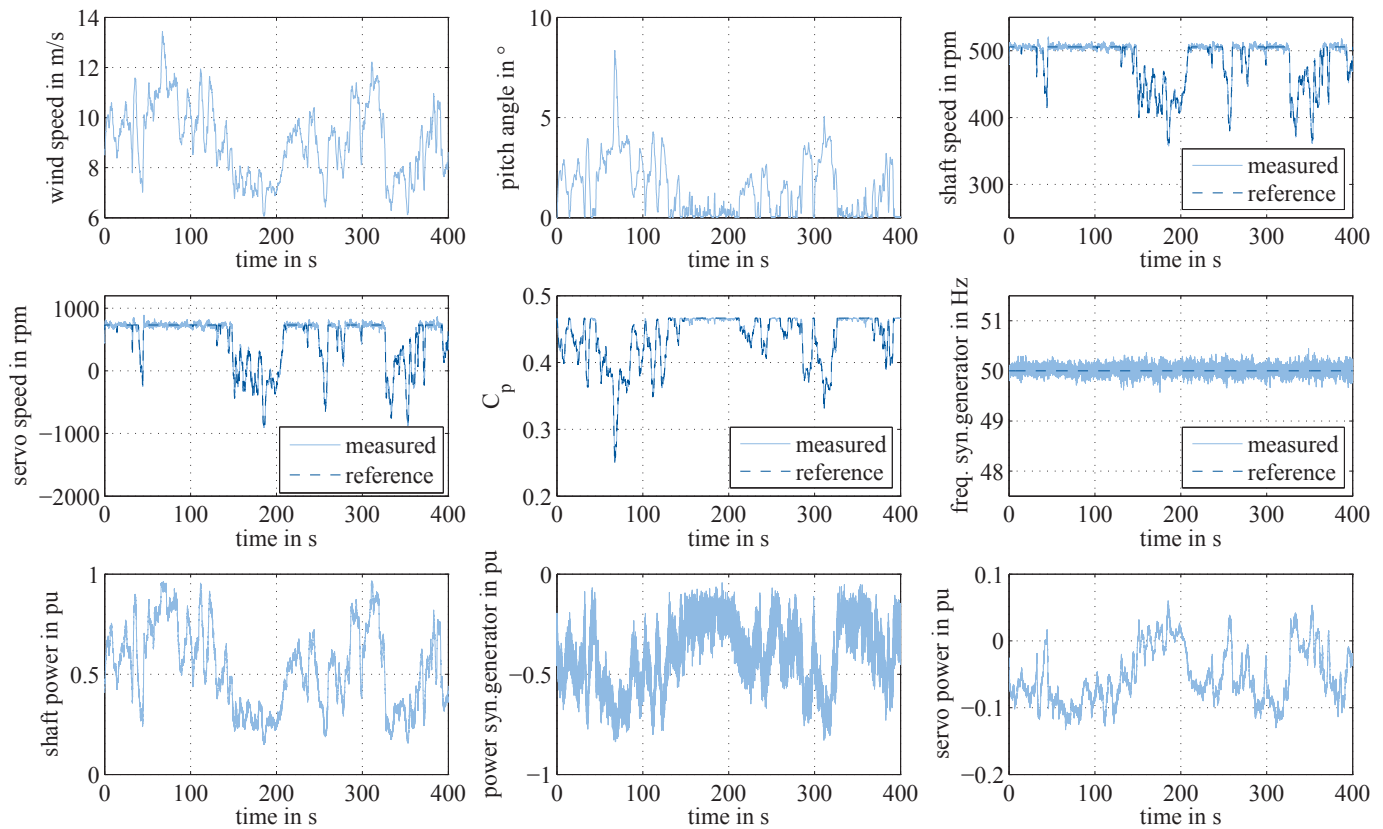


Fig. 14: Experimental results of the wind turbine with stochastic wind speed.

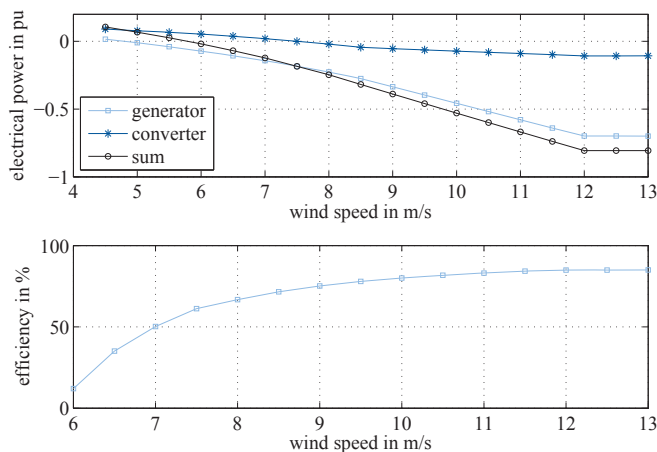


Fig. 15: Measured electrical power and efficiency.

The servo machine is used in both motor and generator operations according to the wind speed. During the variation of the wind speed, the peak mechanical power delivered to the servo PMSM is 0.12 pu.

In order to illustrate the operating curve of the wind turbine with power split, experiments are made at constant wind speed from 4.5 m/s to 13 m/s. The operating power and torque curves of the main shaft are shown in Fig. 12. The ideal curve is the power from the wind turbine without friction losses. Therefore, the measured power and torque on the main shaft are slightly smaller than their ideal values.

The operating curves of the speed and power for the servo PMSM are shown in Fig. 13. The ideal curves in the figure are calculated by the model of the planetary gearbox (3) to (6) without friction losses. As shown in Fig. 13, the speed of the servo PMSM matches its ideal value at different wind speed. The measured power curve deviates slightly from the ideal one due to the losses. When the wind speed is low, the servo PMSM is operated in motor mode and it delivers mechanical power to the planetary gearbox. Therefore, the measured power is larger than its ideal value. While the wind speed is increasing, the servo PMSM is operated in generator mode and it is actuated by the planetary gearbox. In this case, the measured mechanical power is smaller than the ideal value. Since the components in the test bench are oversized with almost doubled rated power of the turbine, the operation of each component is in low efficiency region, particularly at low wind speed. Therefore, the deviation between the ideal and real operating curves of the servo PMSM can be reduced, when the rating of each component is correctly chosen.

With the non-optimum gear ratio of the main gearbox, the mechanical power of the servo PMSM is within 12% of the rated power of the turbine. This indicates a small power ratio of the servo PMSM and its converter, when the PMSM is well designed based on the operating curves. Meanwhile, the electrical power of the converter shown in Fig. 15 is within 10.7% of the rated power of the turbine, which validates the small power ratio. Moreover, when the gear ratios of the gearboxes is towards the optimum condition (8), the power

ratio can approach its ideal optimum 5.8%.

From Fig. 15, the sum of the electrical power from the converter and the synchronous generator, when the wind speed is smaller than 5.5 m/s. This indicates that the wind turbine is absorbing power from the power grid. The reason for this phenomenon is due to the over-dimension of each component in the test bench, which results in the operation in very low efficiency region. When the components of the wind turbine are well dimensioned with the appropriate rated power, the losses are able to be greatly reduced and the wind turbine will generate power to the power grid at low wind speed. The efficiency shown in Fig. 15 is the total efficiency of the planetary gearbox and the electrical system. It is calculated by $\eta = \frac{P_{sum}}{P_{sh}}$, where P_{sum} is the total electrical power to the power grid and P_{sh} is the mechanical power of the main shaft. The efficiency increases with the augment of the wind speed and reaches 85% at the rated operating point. As mentioned in the previous section, the synchronous generator, planetary gearbox and servo machine in the test bench are not optimized and are twice over-dimensioned for the experiments. Each component in the test bench is working in very low load region, which has very low efficiency. Therefore, the efficiency of the wind turbine with mechanical power split can still be greatly improved from 85%, when the rated power of each component are correctly designed.

In order to show the feasibility of the wind speed with power split in a realistic situation, the experimental results for stochastic wind speed with wind gust are shown in Fig. 14. The speeds of the main shaft and servo PMSM track their reference values closely. Moreover, the performance coefficient C_p follows its optimum reference value, which is determined by the power curve of the turbine. In the high wind speed region, the main shaft is kept at its rated speed by the pitch controller. The frequency of the synchronous generator oscillates around 50 Hz at wind gust and sudden wind speed drop. The major part of the mechanical power is delivered to the synchronous generator during the transient operation. The power delivered to the servo PMSM is within 0.12 pu with stochastic wind.

VI. CONCLUSIONS

In this paper, the structure, power split behavior and control strategy of a novel concept wind turbine with mechanical power split are introduced and validated by the experiments. The synchronous generator in the wind turbine is directly connected to the power grid and the reactive power can be easily controlled by its excitation system. With the control of the servo PMSM and the pitch control, the optimum TSR and MPPT for the wind turbine are achieved. Both theoretically and experimental results show the small power ratio of the back-to-back converter of the wind turbine with power split. This shows the possibility to reduce the power electronic devices in wind turbines. The feasibility and transient performance of the wind turbine are validated by experimental results for ramp and stochastic wind speed. Since the wind turbine with power split is with a small scale converter and without a DFIG, it overcomes the difficulties in WT-DFIG and WT-SG with large power class. Therefore, the wind turbine

with power split can be considered as a potential candidate for large scale wind turbines.

ACKNOWLEDGMENT

This work was supported by the Ziel-2-Programm NRW 2007-2013 "Regionale Wettbewerbsfähigkeit und Beschäftigung" (EFRE).

APPENDIX A

TABLE I: MECHANICAL PARAMETERS OF THE TEST BENCH

Rated turbine power	$P_{t,N}$	110 kW
Rated turbine speed	$\omega_{t,N}$	14.19 rpm
Cut-in wind speed	$v_{w,in}$	4 m/s
Rated wind speed	$v_{w,N}$	12 m/s
Cut-off wind speed	$v_{w,off}$	20 m/s
Radius turbine rotor	R_t	9.78 m
Gear ratio main gearbox	i_m	35.64
Gear ratio plus planetary	i_0	-2.41
Gear ratio transmission gearbox	i_z	7.83

REFERENCES

- [1] F. Blaabjerg and K. Ma, "Future on power electronics for wind turbine systems," *IEEE Trans. Emerg. Sel. Topics Power Electron.*, vol. 1, pp. 139–152, Sept. 2013.
- [2] H. A. Mohammadpour and E. Santi, "Modeling and control of gate-controlled series capacitor interfaced with a dfig-based wind farm," *IEEE Trans. Ind. Electron.*, vol. 62, pp. 1022–1033, Feb. 2015.
- [3] D. Zhou, F. Blaabjerg, M. Lau, and M. Tønnes, "Optimized reactive power flow of dfig power converters for better reliability performance considering grid codes," *IEEE Trans. Ind. Electron.*, vol. 62, pp. 1552–1562, Mar. 2015.
- [4] F. Fateh, W. N. White, and D. Gruenbacher, "A maximum power tracking technique for grid-connected dfig-based wind turbines," *IEEE Trans. Emerg. Sel. Topics Power Electron.*, vol. 3, pp. 957–966, Dec. 2015.
- [5] V. D. Colli, F. Marignetti, and C. Attaianesi, "Analytical and multi-physics approach to the optimal design of a 10-mw dfig for direct-drive wind turbines," *IEEE Trans. Ind. Electron.*, vol. 59, pp. 2791–2799, Jul. 2012.
- [6] H. Li and Z. Chen, "Overview of different wind generator systems and their comparisons," *Renewable Power Generation, IET*, vol. 2, pp. 123–138, Jun. 2008.
- [7] D. Zhou, F. Blaabjerg, T. Franke, M. Tønnes, and M. Lau, "Comparison of wind power converter reliability with low-speed and medium-speed permanent-magnet synchronous generators," *IEEE Trans. Ind. Electron.*, vol. 62, pp. 6575–6584, Oct. 2015.
- [8] J. Carroll, A. McDonald, and D. McMillan, "Reliability comparison of wind turbines with dfig and pmg drive trains," *IEEE Trans. Energy Convers.*, vol. 30, pp. 663–670, Jun. 2015.
- [9] Ingeteam. (2016) xdfm 500-6000. [Online]. Available: www.ingeteam.com/mx/en-us/energy/wind-power-energy/pl5_23_253_22/xdfm-500-6000.aspx
- [10] X. Rui, L. Li, and X. Li, "Fundamentals of a power splitting driving chain for large wind turbines," in *7th World Congress on Intelligent Control and Automation, 2008 (WCICA 2008)*, Jun. 2008, pp. 9347–9350.
- [11] Q. Liu, R. Appunn, and K. Hameyer, "A study of a novel wind turbine concept with power split gearbox," in *International Conference on Electrical Machines and Systems (ICEMS), 2013*, Oct. 2013, pp. 218–222.
- [12] Q. Liu, R. Appunn, K. Hameyer, C. Ridder, and E. A. Werner, "Structure and control strategy of a new wind turbine concept with power split," in *2nd Conference for Wind Power Drives (CWD2015)*, Mar. 2015, pp. 515–528.
- [13] T. Ackermann, *Wind Power in Power Systems*, T. Ackermann, Ed. John Wiley & Sons, 2005.
- [14] E. Muljadi and C. Butterfield, "Pitch-controlled variable-speed wind turbine generation," *IEEE Trans. Ind. Appl.*, vol. 37, pp. 240–246, Jan. 2001.

- [15] H. Lee and Y. Choi, "A new actuator system using dual-motors and a planetary gear," *IEEE/ASME Trans. Mechatronics*, vol. 17, pp. 192–197, Feb. 2012.
- [16] J. Zhang, J. S. Dhupia, and C. J. Gajanayak, "Stator current analysis from electrical machines using resonance residual technique to detect faults in planetary gearboxes," *IEEE Trans. Ind. Electron.*, vol. 62, pp. 5709–5721, Sept. 2015.
- [17] S. Seetharaman, A. Kahraman, M. Moorhead, and Petry-Johnson, "Oil churning power losses of a gear pair: experiments and model validation," *Journal of Tribology*, vol. 131, pp. 022 202–1–022 202–10, Feb. 2009.
- [18] G. Sieros, P. Chaviaropoulos, J. Sørensen, B. Bulder, and P. Jamieson, "Upscaling wind turbines: theoretical and practical aspects and their impact on the cost of energy," *Wind Energy*, vol. 15, pp. 3–17, Jan. 2012.
- [19] A. Merabet, K. T. Ahmed, H. Ibrahim, and R. Beguenane, "Implementation of sliding mode control system for generator and grid sides control of wind energy conversion system," *IEEE Trans. Sustain. Energy*, vol. 7, pp. 1327–1335, Jul. 2016.
- [20] J. Machowski, J. Bialek, and J. Bumby, *Power system dynamics: stability and control*. John Wiley & Sons, 2011.
- [21] M. Cirrincione, M. Pucci, and G. Vitale, "Neural mppt of variable-pitch wind generators with induction machines in a wide wind speed range," *IEEE Trans. Ind. Appl.*, vol. 49, pp. 942 – 953, Mar. 2013.
- [22] G. Jenkins and V. Hamidi, "Assessment of fault ride through requirement for distributed generators," in *3rd Renewable Power Generation Conference (RPG 2014)*, Sept. 2014, pp. 1–4.



Qian Liu finished his Bachelor in Electrical Engineering in 2008 at Shanghai Jiao Tong University, China. In 2011 he received his Master degree in Control Engineering from Technical University of Kaiserslautern, Germany. Currently he is a research associate in the Institute of Electrical Machines at RWTH Aachen University, Germany. His research focuses on high performance PMSM drive system and power electronics in electrical vehicles and wind turbines.



Rüdiger Appunn received the M.Sc. degree in electrical engineering in 2008 and the Ph.D. degree in 2015, from RWTH Aachen University, Germany. He worked as research associate, group leader and chief engineer at the Institute of Electrical Machines, RWTH Aachen University from 2008 until 2015. Since 2015 he is with thyssenkrupp Transrapid. His research fields include magnetic levitation, mechatronics and inductive power transmission.



Kay Hameyer (M'96-SM'99) Received 1986 the M.Sc. degree in electrical engineering from the University of Hannover, Germany, 1992 his Ph.D. degree from University of Technology Berlin, Germany for working on permanent magnet excited machines. After his university studies he worked with the Robert Bosch GmbH in Stuttgart, Germany, as a design engineer for permanent magnet servo motors. From 1988 to 1993 he was a member of staff at the University of Technology Berlin, Germany. From 1996 to 2004, he was then a Full Professor of Numerical Field Computations and Electrical Machines, Katholieke Universiteit Leuven (KU Leuven), Leuven, Belgium. Since 2004, he has been a Full Professor and the Director of the Institute of Electrical Machines (IEM), RWTH Aachen University, Aachen, Germany. His research interest focuses on all aspects of the design, control and manufacturing of electrical machines and the associated numerical simulation. The characterization and modeling of hard- and soft-magnetic materials is another focus of his work. He has authored/coauthored more than 250 journal publications, more than 500 international conference publications and four books. His research interests include numerical field computation and optimization, the design and control of electrical machines, in particular, permanent-magnet excited machines, induction machines. Dr. Hameyer is since 2004 a member of the German VDE and since 2002 a Fellow of the Institution of Engineering and Technology, U.K.